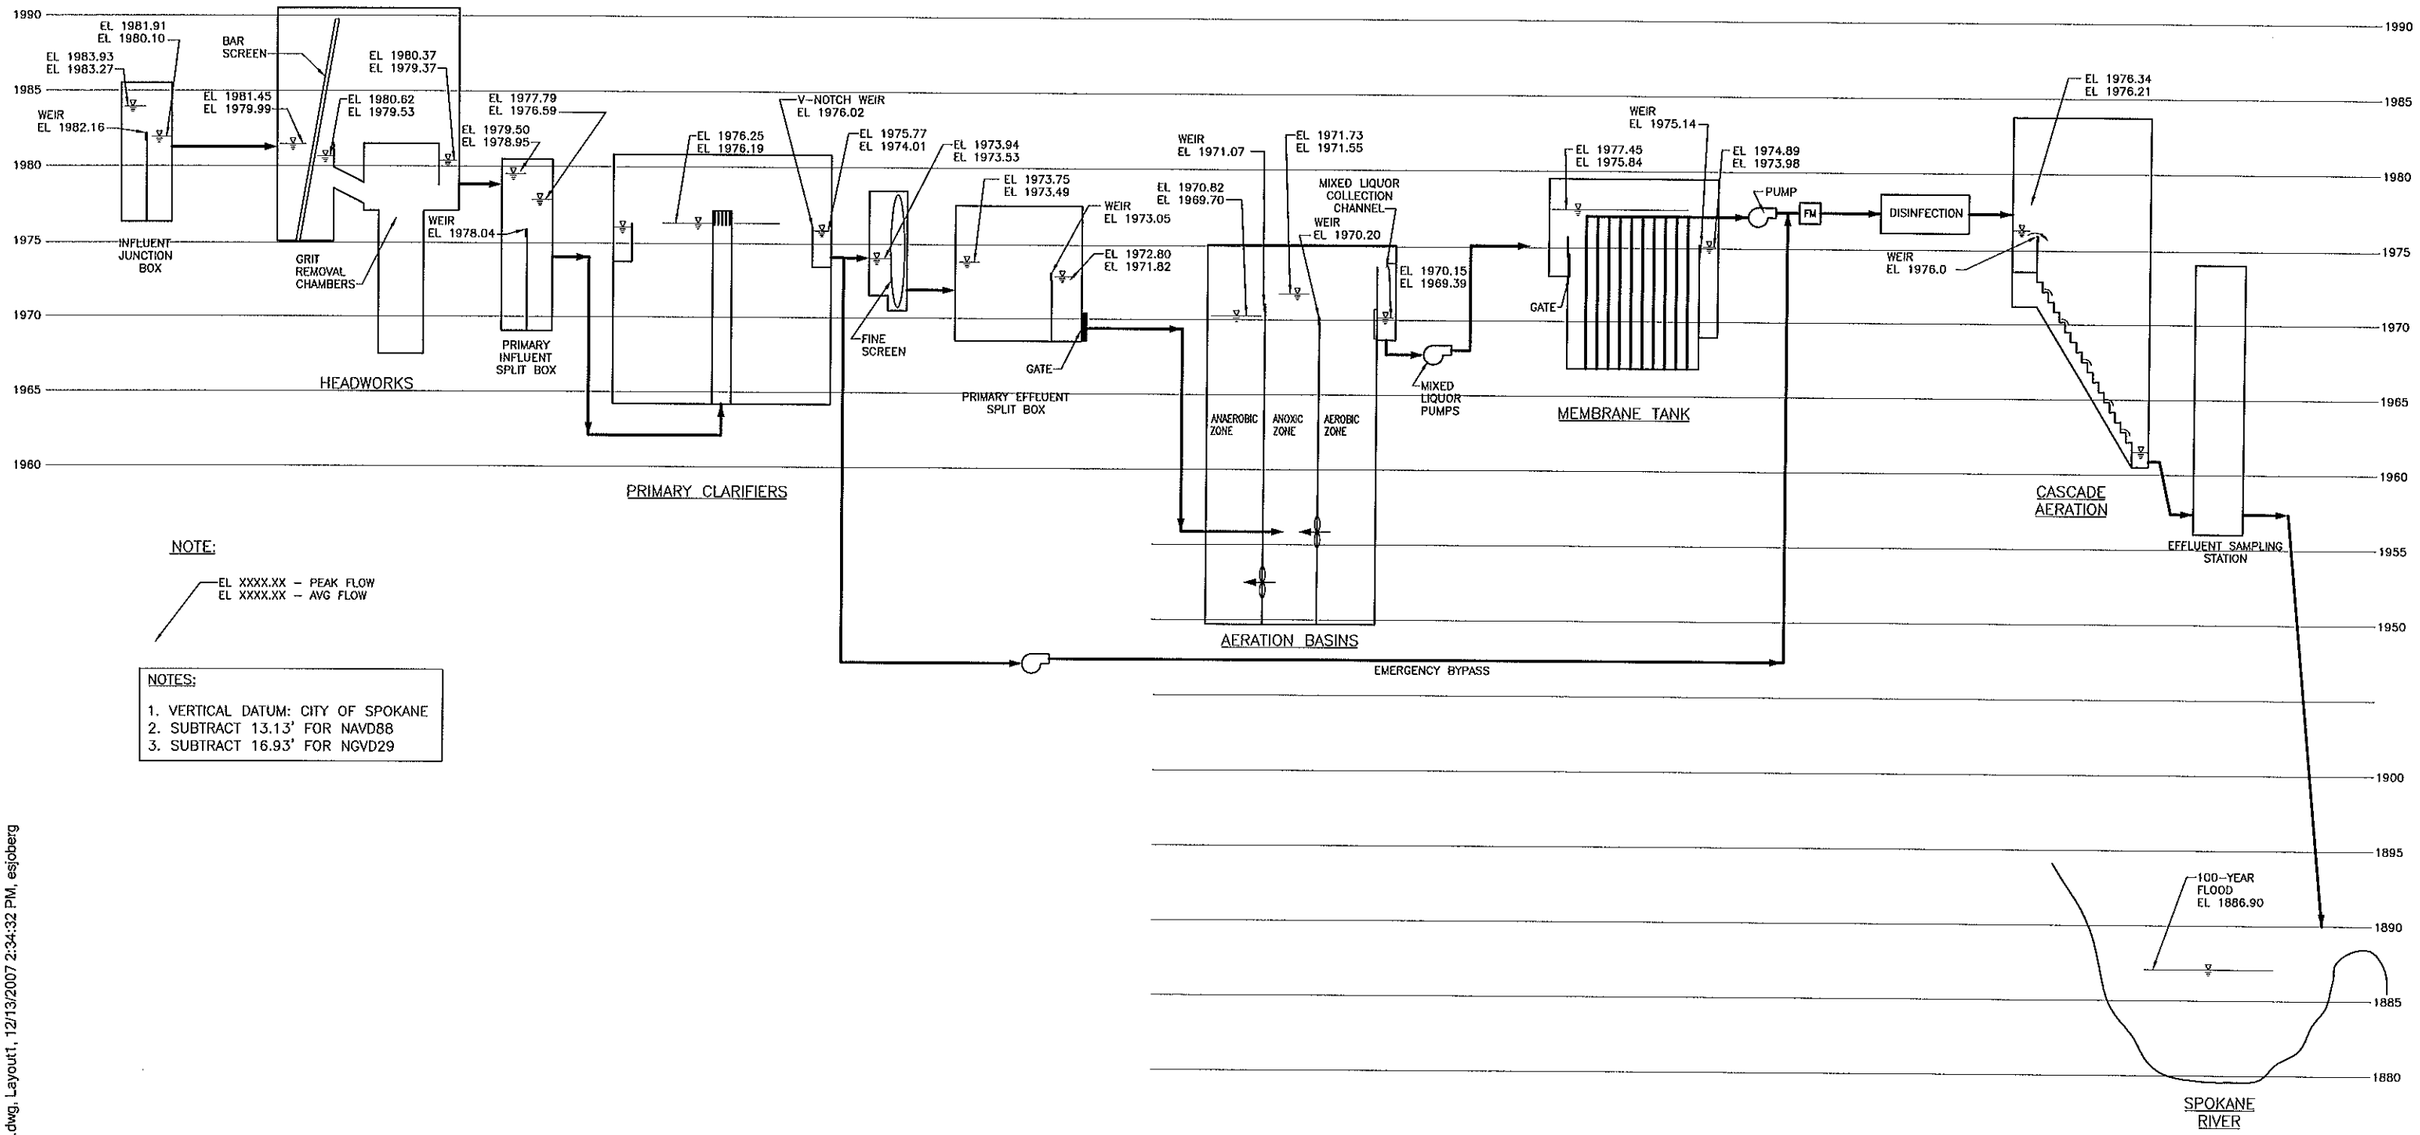

NOTE:

EL XXXX.XX – PEAK FLOW
EL XXXX.XX – AVG FLOW

NOTES:

1. VERTICAL DATUM: CITY OF SPOKANE
2. SUBTRACT 13.13' FOR NAVD88
3. SUBTRACT 16.93' FOR NGVD29

C:\PWworking\SEA\d0107647\Dwg-6-4.dwg, Layout1, 12/13/2007 2:34:32 PM, esjoberg

HDR

HDR Engineering, Inc.

2006 Wastewater Facilities Plan Amendment
Spokane County Regional Water Reclamation Facility

Drawing 6-4 HYDRAULIC PROFILE